


1 FIRST FLOOR PLAN
1/4" = 1'-0"

WALL LEGEND

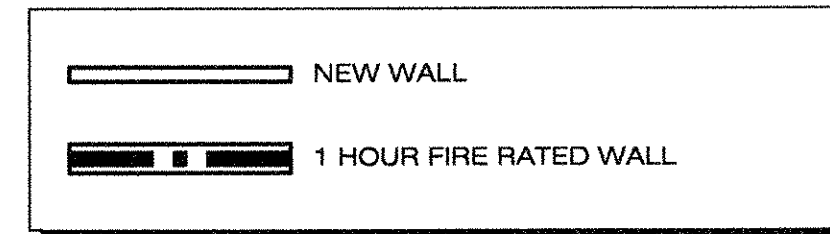

NOTES

- 1 DENTAL EQUIPMENT- SEE DENTAL CONSULTANTS DRAWINGS (TYP.)
- 2 APPLIANCES BY OWNER
- 3 FURNITURE BY OWNER. N.I.C.

PARTITION TYPES

TYPE	RATING	UL LABEL	PLAN DETAIL	CONSTRUCTION	WIDTH 'X'
P-1	NONE	N/A		ONE LAYER OF 5/8" GYPSUM BOARD ON INTERIOR SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ R-19 THERMAL INSULATION, 3/4" OSB, CULTURED STONE VENEER AND HARDIE SHAKE SIDING ON EXTERIOR SIDE.	6 3/4"
P-2	NONE	N/A		ONE LAYER OF 5/8" GYPSUM BOARD ON INTERIOR SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ R-19 THERMAL INSULATION, 3/4" OSB, CULTURED STONE VENEER AND HARDIE SHAKE SIDING ON EXTERIOR SIDE.	4 3/4"
P-3	NONE	N/A		2x4 WOOD STUDS @ 16" O.C. W/ R-19 THERMAL INSULATION, 3/4" OSB, STONE VENEER AND HARDIE SHAKE SIDING ON EXTERIOR SIDE, INTERIOR SIDE NON-FINISHED.	5 1/2"
P-4	1 HOUR RATED	1/FP 1.1		ONE LAYER OF 5/8" TYPE "X" GYPSUM BOARD ON EACH SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ R-19 THERMAL INSULATION.	4 3/4"
P-5	NONE	N/A		ONE LAYER OF 5/8" GYPSUM BOARD ON EACH SIDE OF 2x4 WOOD STUDS @ 16" O.C.	4 3/4"
P-6	NONE	N/A		ONE LAYER OF 5/8" GYPSUM BOARD ON EACH SIDE OF 2x4 WOOD STUDS @ 16" O.C.	6 3/4"
P-7	1 HOUR RATED	1/FP 1.1		ONE LAYER OF 5/8" TYPE "X" GYPSUM BOARD ON EACH SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ R-19 THERMAL INSULATION.	6 3/4"
P-8	NONE	N/A		ONE LAYER OF 5/8" GYPSUM BOARD ON "DRY WALL" SIDE AND ONE LAYER OF 3/4" DENS SHIELD ON "WET WALL" SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ 5" SOUND BLANKETS.	4 3/4"
P-9	NONE	N/A		ONE LAYER OF 5/8" GYPSUM BOARD ON INT. SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ R-19 THERMAL INSULATION, 3/4" OSB, CULTURED STONE VENEER AND HARDIE SHAKE SIDING ON EXTERIOR SIDE.	11 1/2"
P-10	NONE	N/A		ONE LAYER OF 5/8" DENS SHIELD & ONE LAYER OF 3/4" DENS SHIELD ON EXTERIOR SIDE OF 2x4 WOOD STUDS @ 16" O.C. W/ 5" SOUND BLANKETS.	4 3/4"

NOTE: USE 3/4" OSB ON EXTERIOR SIDE OF ALL EXTERIOR WALLS (TYPICAL)

NOTE: USE 5/8" DENS SHIELD @ ALL WET WALLS

NOTE: WET WALLS @ FIRE-RATED WALLS SHALL USE 3/4" DENS SHIELD TYPE "X" GYPSUM BOARD.


PARTITION NOTES

- WOOD AND PLYWOOD BLOCKING SHALL BE FIRE RETARDANT TREATED.
- PENETRATIONS THROUGH WALLS SHALL CONTAIN CONTINUOUS FIRESTOPPING THROUGH FIRE RATED PARTITIONS OR CONTINUOUS ACOUSTICAL SEALANT THROUGH NON RATED PARTITIONS.
- ALL WET ROOMS AND WET AREAS SHALL BE CONSTRUCTED WITH 5/8" DENS SHIELD TILE BACKER BOARD.
- ALL RATED GYPSUM BOARD PARTITIONS WILL USE FIRECODE GYPSUM BOARD AND BE CONSTRUCTED IN STRICT ACCORDANCE WITH THE DESIGN UL CONSTRUCTION.

GENERAL NOTES

- BEFORE PROCEEDING WITH WORK VERIFY EXISTING CONDITION. IF CONDITIONS ENCOUNTERED DIFFER FROM CONDITIONS SHOWN IN DRAWINGS PLEASE NOTIFY JEFFERSON BROWNE, INC.
- FIRE EXTINGUISHERS SHALL BE SELECTED, INSTALLED AND MAINTAINED IN ACCORDANCE WITH SECTION 906.2 AND NFPA 10.

1 HR. FIRE RATED MEDGAS CLOSET

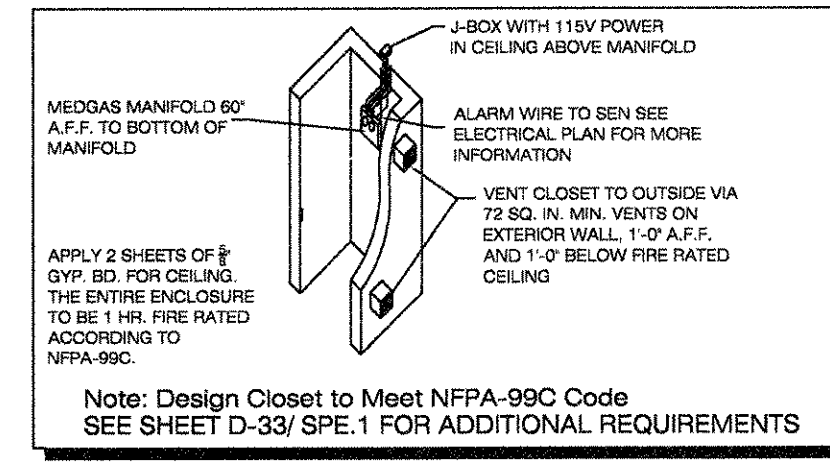

2 MEDGAS CLOSET DETAIL
1/4" = 1'-0"


HOURLY RATE STENCIL NOTE

- EXISTING CONDITIONS, INFORMATION TO BE VERIFIED PRIOR TO CONSTRUCTION.
- ALL FIRE WALLS SHALL BE PERMANENTLY IDENTIFIED WITH STENCILING ABOVE ALL ACOUSTICAL CELLINGS WITH A MIN. OF 2" HIGH 1" LETTERING AT 4" MAX. OF 12" O.C. WITH A MIN. OF ONE PER WALL OR BARRIER. THE HOURLY RATING SHALL BE ON ALL RATED BARRIERS OR WALLS. SUGGESTED WORDING:
EXAMPLES: *1 HOUR FIRE WALL - PROTECT ALL OPENINGS;
*2 HOUR FIRE WALL - PROTECT ALL OPENINGS;
*SMOKE BARRIER - PROTECT ALL OPENINGS;

REVISIONS

NO.	DESCRIPTION

QUAD A
4508 HOLLY SPRINGS PKWY
CANTON, GEORGIA 30115
11-1502

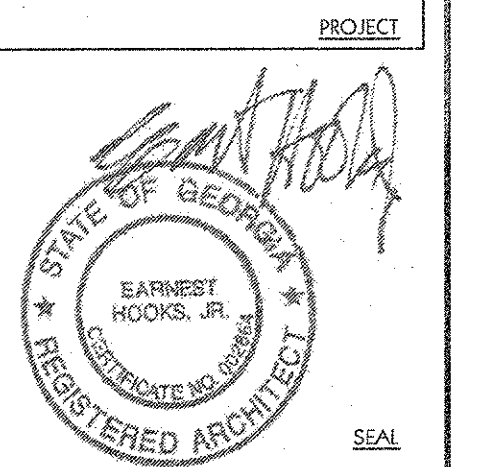

FEBRUARY 28, 2011
CONSTRUCTION SET
RELEASED FOR CONSTRUCTION

PORTE COCHERE
PLAN & LEGENDS

© COPYRIGHT 2011 JEFFERSON BROWNE, INC. THIS DOCUMENT AS AN INSTRUMENT OF SERVICE REMAINS THE PROPERTY OF JEFFERSON BROWNE, INC. AND NO PART THEREOF MAY BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM JEFFERSON BROWNE, INC.

Drawn By: J.B. OGDON
Checked By: J.B. OGDON
PROJECT #
SHEET NO. **A1.2**
SHEET 05 of 39